
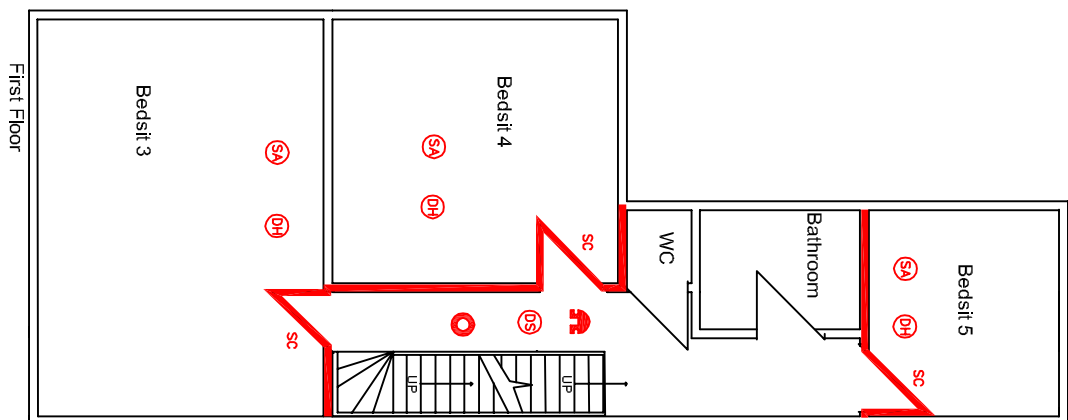
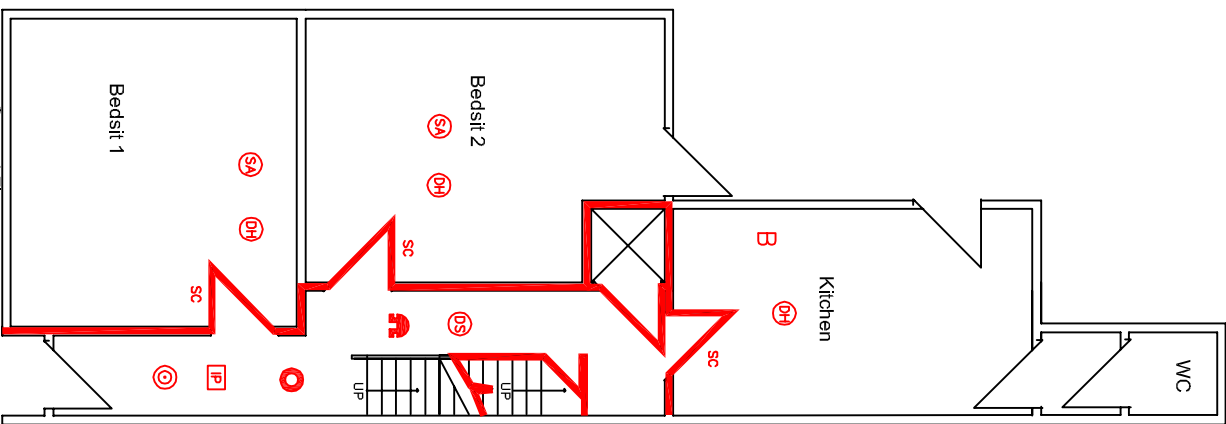
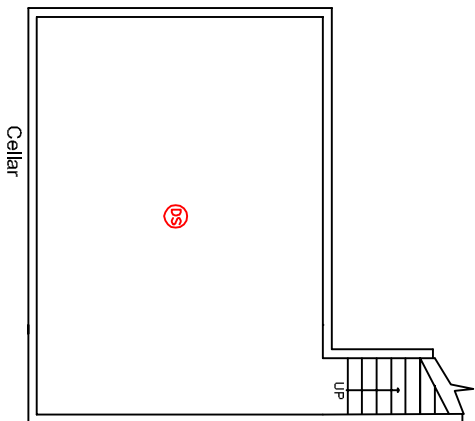


DRAWING NO. 28

3 Storey property with cellar
Bedits on all floors

January 2009

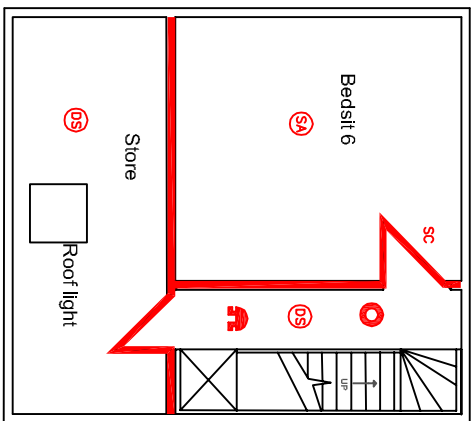

KEY

- (DS) Smoke detector linked to whole house system
- (DH) Heat detector linked to whole house system
- (SA) Smoke alarm with internal sounder - not linked to whole house system
- (C) Manual call point linked to whole house system
- (F) Sounder linked to whole house system
- (IP) Control and indicator panel linked to whole house system
- (C) Emergency lighting
- FD30S fire door with self closing device
- 30 minutes fire resistance